
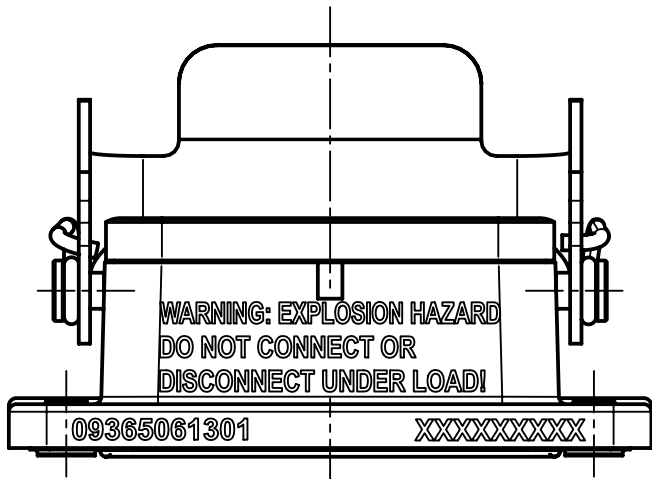
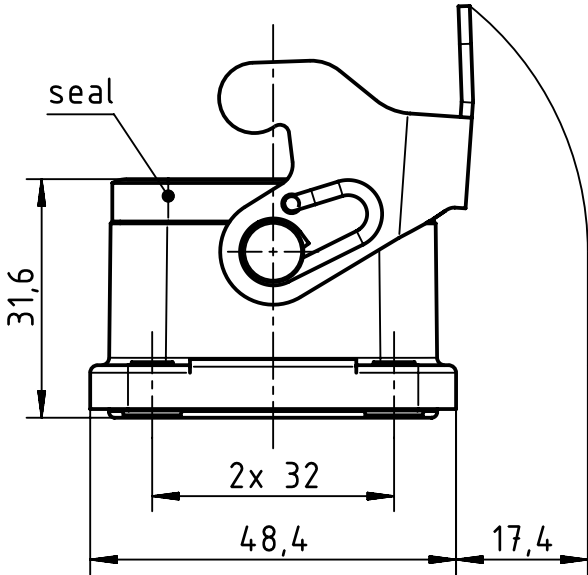
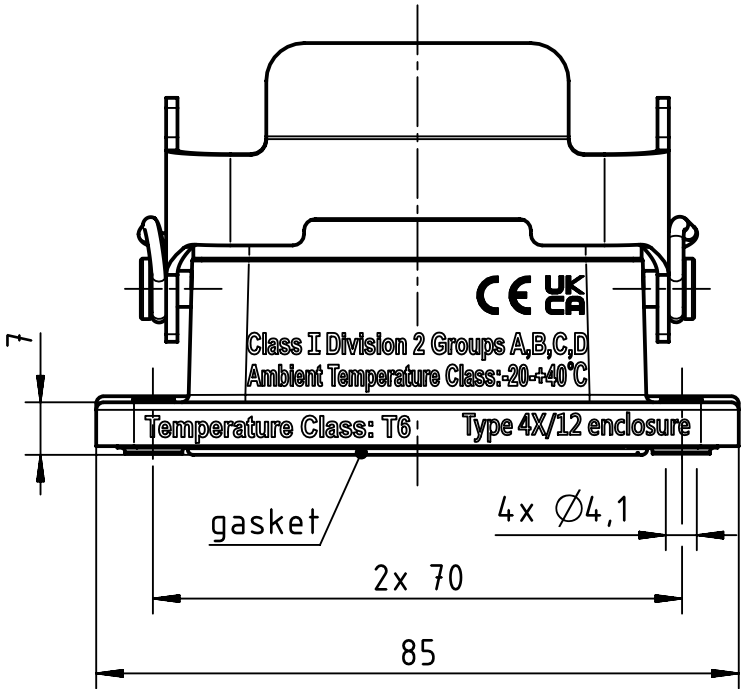


FOR USE WITH AWG 12, 14 AND 16


FOR USE WITH CABLE TYPE:
PLTC, PLTC-ER, ITC, ITC-ER, MC, MV AND TC

FOR USE IN CLASS I, DIVISION 2 GROUPS A, B, C AND D
HAZARDOUS LOCATIONS OR UNCLASSIFIED LOCATIONS



THE INSTALLATION MUST BE IN
ACCORDANCE WITH THE
ASSOCIATED LOCATION
RESTRICTIONS OF THE NATIONAL
ELECTRIC CODE OR CANADIAN
ELECTRICAL CODE AS
APPLICABLE, INCLUDING ISSUES
SUCH AS THE ROUTING,
SUPPORT AND LENGTH OF THE
INVOLVED CORD OR CABLE.

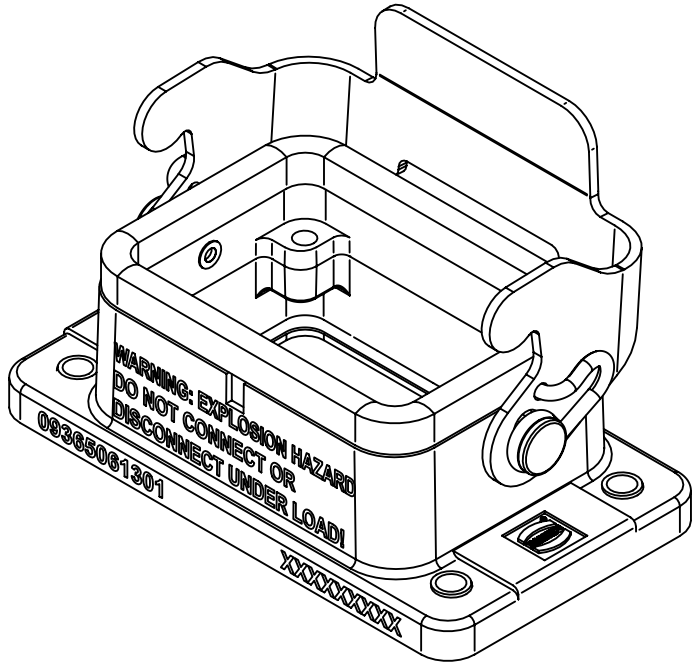

WARNING
EXPLOSION HAZARD
DO NOT CONNECT
OR DISCONNECT
UNDER LOAD!

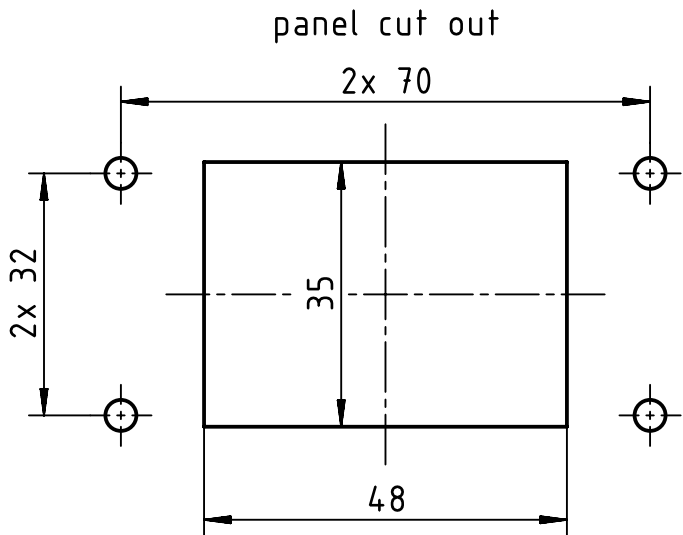

		All Dimensions in mm Original Size DIN A3		Scale 1:1		Free size tol.		Ref.				
								Sub.				
	All rights reserved		Created by longl		Inspected by wangst		Standardisation		Date 25-Jun-2025		State 40 - Released	
	Department EL PD		Title HAN 6EX UL-AGG-LB								Doc-Key / ECM-Nr. DS00199106	
HARTING D-32339 Espelkamp			Type TB		Design Number DS00199106			SAP Mat. Number 09365061301			Rev. E	Page 1/2

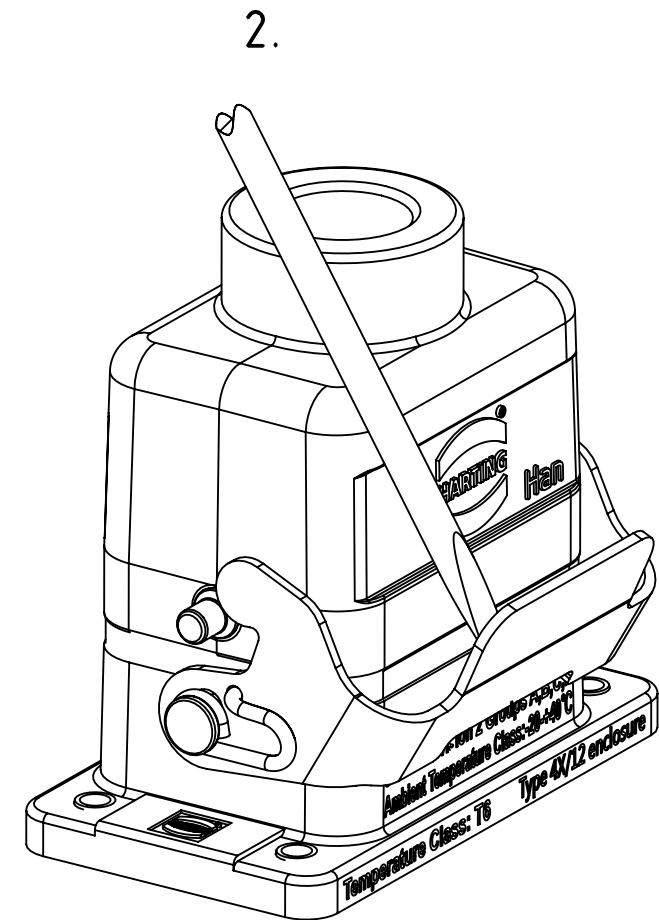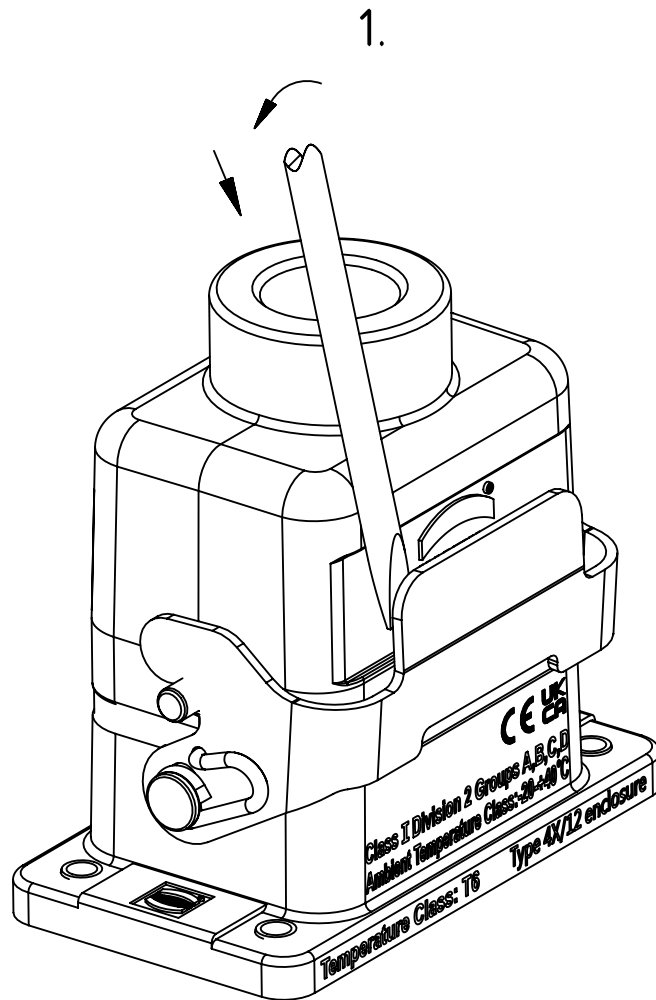

To separate connectors, insert small flat head tool or screwdriver between metal lever and housing as shown in the diagram,. Press screwdriver in a downward direction until the metal lever releases.

To secure the hood and housing assembly together, press the metal levers in the upward direction until metal lever latches into housing pins.