
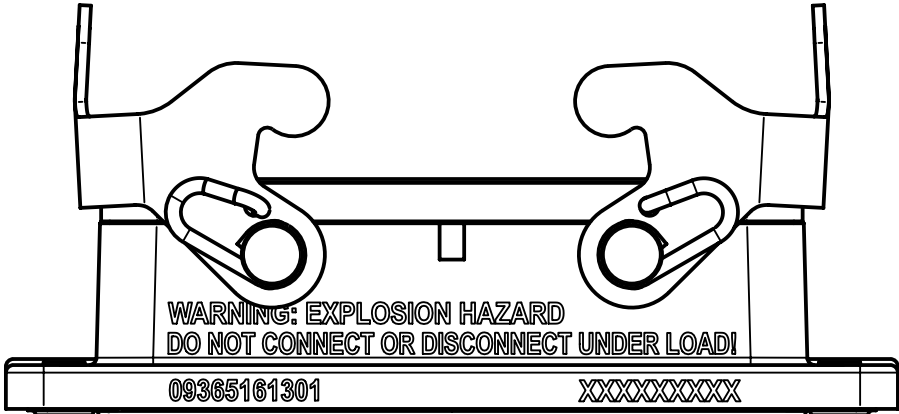
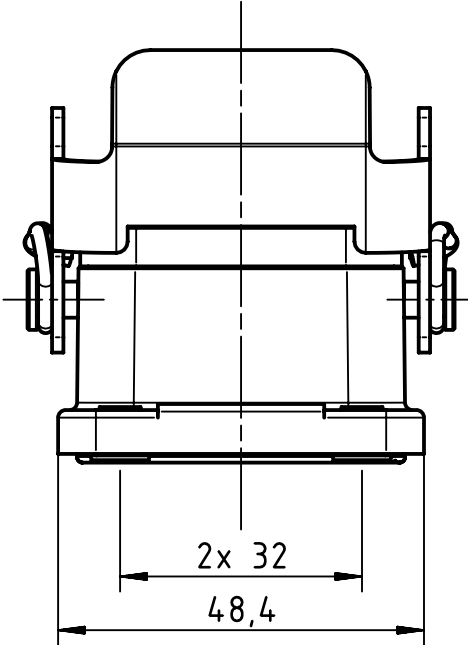


FOR USE WITH AWG 12, 14 AND 16


FOR USE WITH CABLE TYPE:
PLTC, PLTC-ER, ITC, ITC-ER, MC, MV AND TC

FOR USE IN CLASS 1, DIVISION 2, GROUP A,B,C, AND D
HAZARDOUS LOCATIONS OR UNCLASSIFIED LOCATIONS


THE INSTALLATION MUST BE IN
ACCORDANCE WITH THE ASSOCIATED LOCATION
RESTRICTIONS OF THE NATIONAL ELECTRIC CODE
OR CANADIAN ELECTRICAL CODE AS APPLICABLE,
INCLUDING ISSUES SUCH AS ROUTING, SUPPORT
AND LENGTH OF THE INVOLVED CODE OR CABLE.

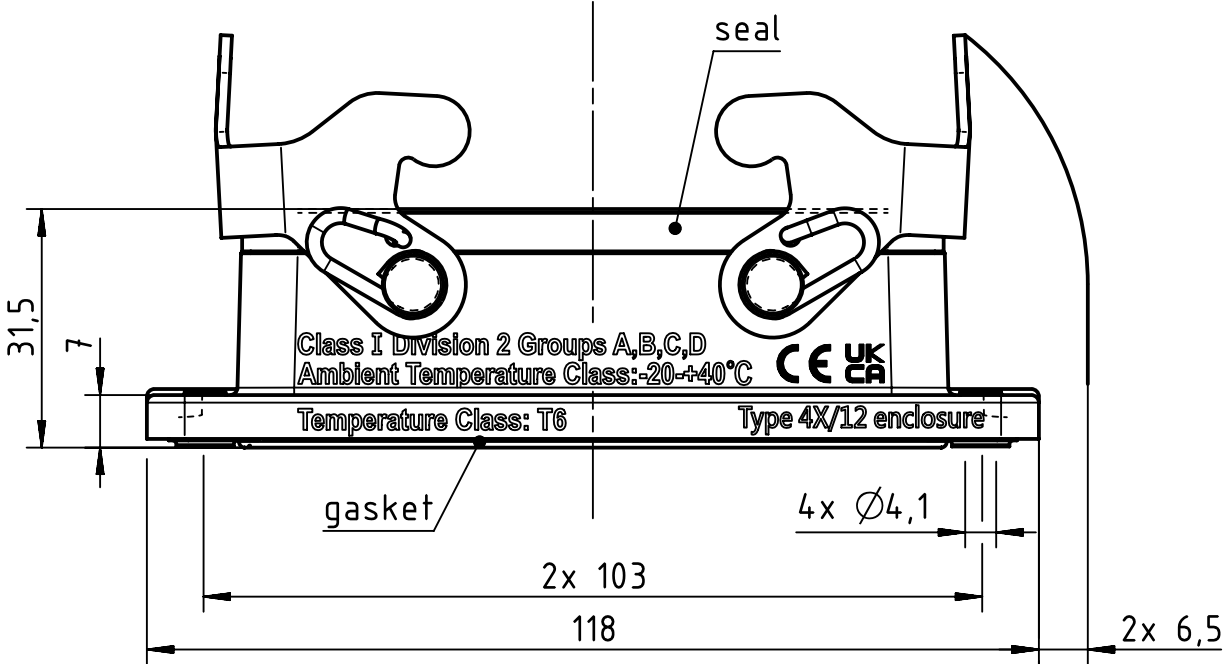



WARNING
EXPLOSION HAZARD
DO NOT CONNECT
OR DISCONNECT
UNDER LOAD!

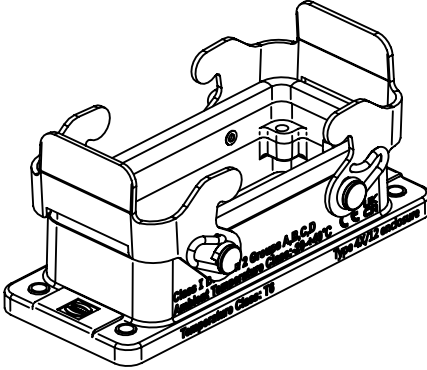

panel cut out (1:1)

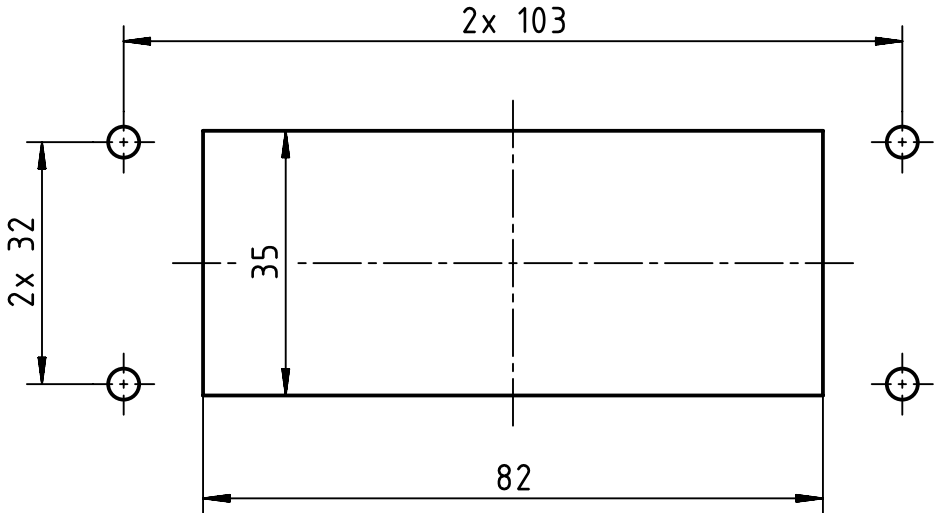

		All Dimensions in mm Original Size DIN A3		Scale 1:1		Free size tol.		Ref.					
								Sub.					
	All rights reserved		Created by longl		Inspected by wangst		Standardisation		Date 25-Jun-2025		State 40 - Released		
	Department EL PD												
HARTING D-32339 Espelkamp				Title Han 16Ex UL-AGG-QB								Doc-Key / ECM-Nr. DS00199069	
				Type TB		Design Number DS00199069			SAP Mat. Number 09365161301			Rev. E	Page 1/2

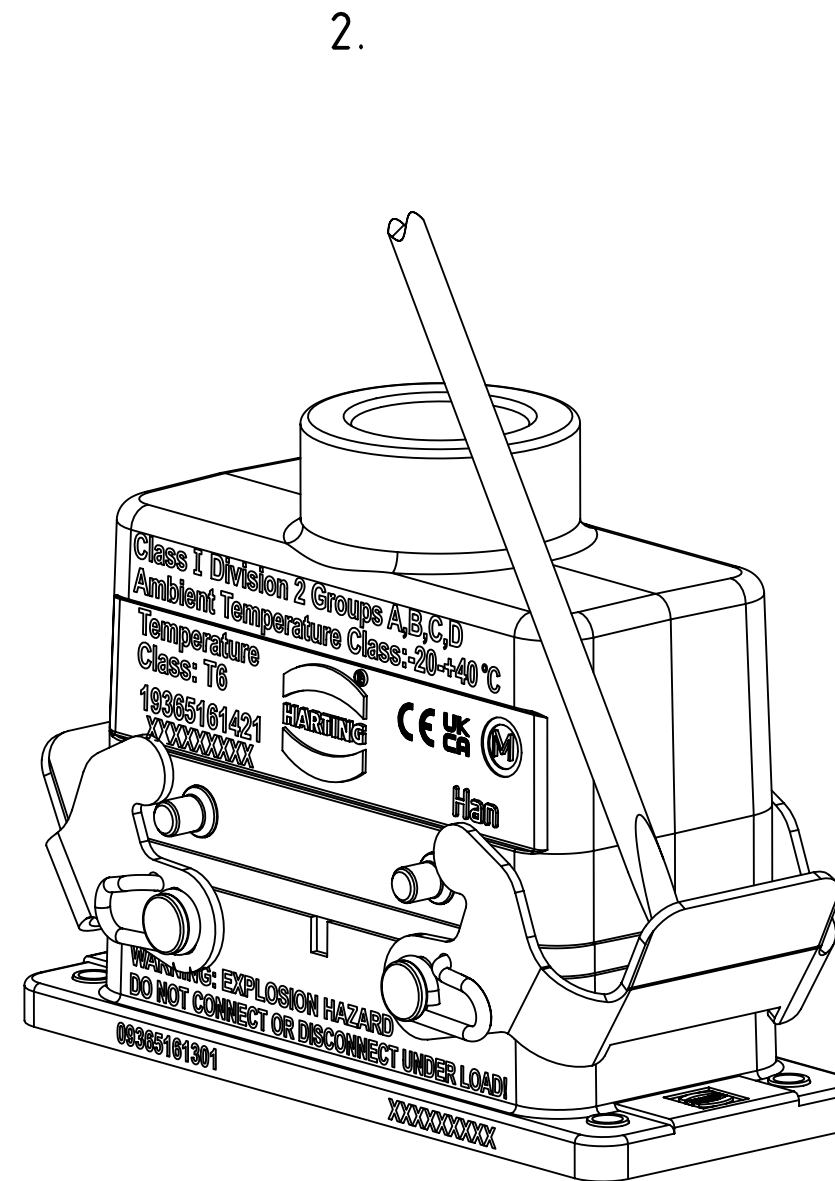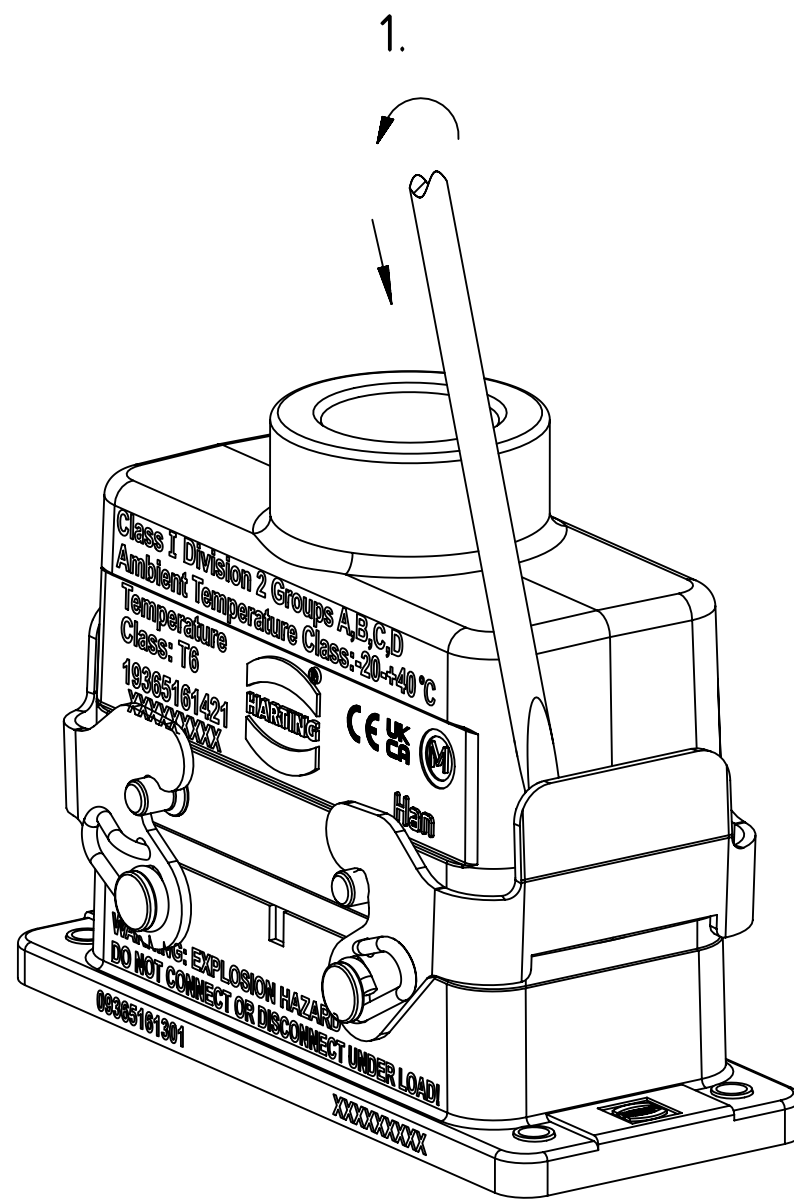

To separate connector, insert small flat head tool or screwdriver between metal lever and housing as shown in the diagram, press the screwdriver in a downward direction until the metal lever releases.

To secure the hood and housing assembly together, press the metal lever upward direction until metal lever latches into housing pins.