
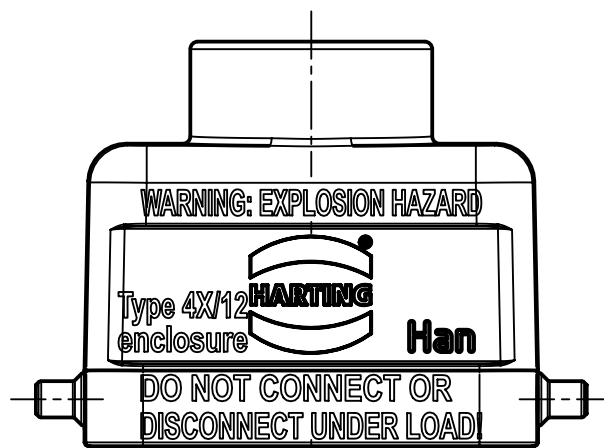
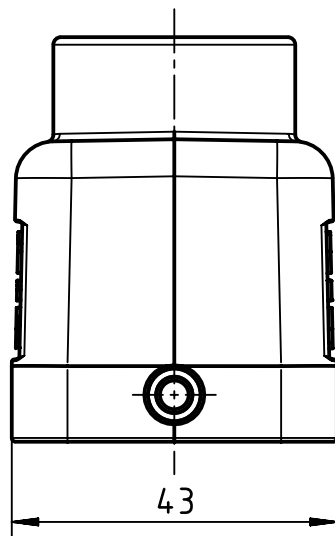
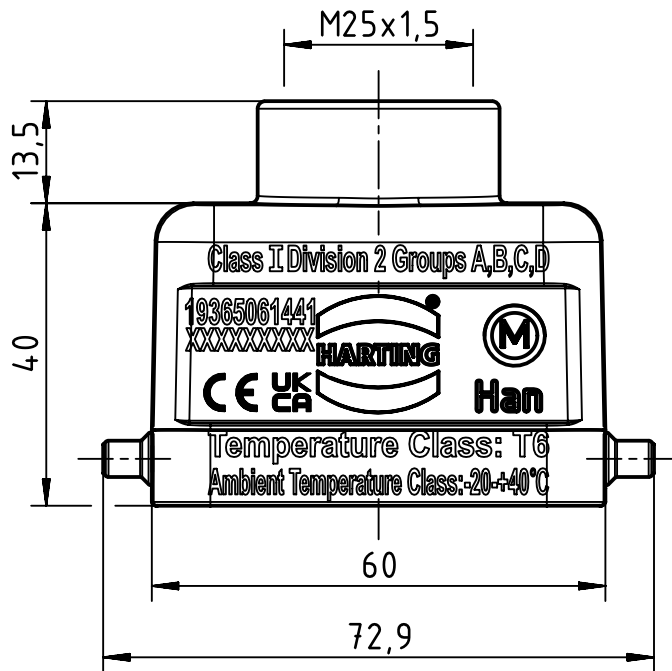


FOR USE WITH AWG 12, 14 AND 16

FOR USE WITH CABLE TYPE:
PLTC, PLTC-ER, ITC, ITC-ER, MC, MV AND TC



FOR USE IN CLASS I, DIVISION 2 GROUPS A, B, C AND D
HAZARDOUS LOCATIONS OR UNCLASSIFIED LOCATIONS

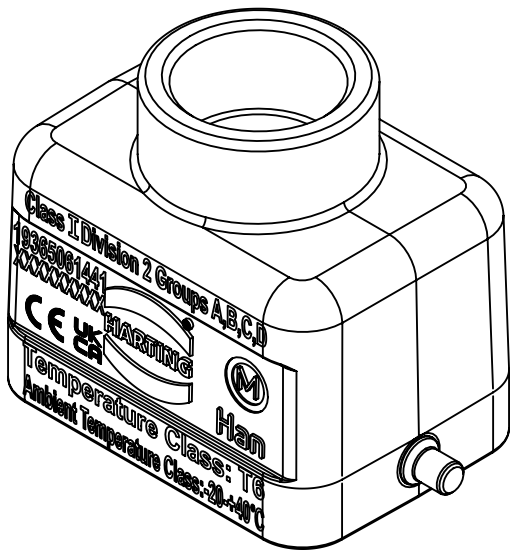

WARNING
EXPLOSION HAZARD
DO NOT CONNECT
OR DISCONNECT
UNDER LOAD!

THE INSTALLATION MUST BE IN ACCORDANCE WITH THE ASSOCIATED LOCATION RESTRICTIONS OF THE NATIONAL ELECTRIC CODE OR CANADIAN ELECTRICAL CODE AS APPLICABLE, INCLUDING ISSUES SUCH AS THE ROUTING, SUPPORT AND LENGTH OF THE INVOLVED CORD OR CABLE.

	All Dimensions in mm Original Size DIN A3		Scale 1:1		Free size tol.		Ref.	
							Sub.	
	All rights reserved		Created by longl		Inspected by wangst		Standardisation	
	Department EL PD						Date 25-Jun-2025	
HARTING D-32339 Espelkamp			Title HAN 6EX UL-HTE-M25				State 40 - Released	
			Type TB		Design Number DS00199109		SAP Mat. Number 19365061441	
						Doc-Key / ECM-Nr. DS00199109		Rev. D
								Page 1/2

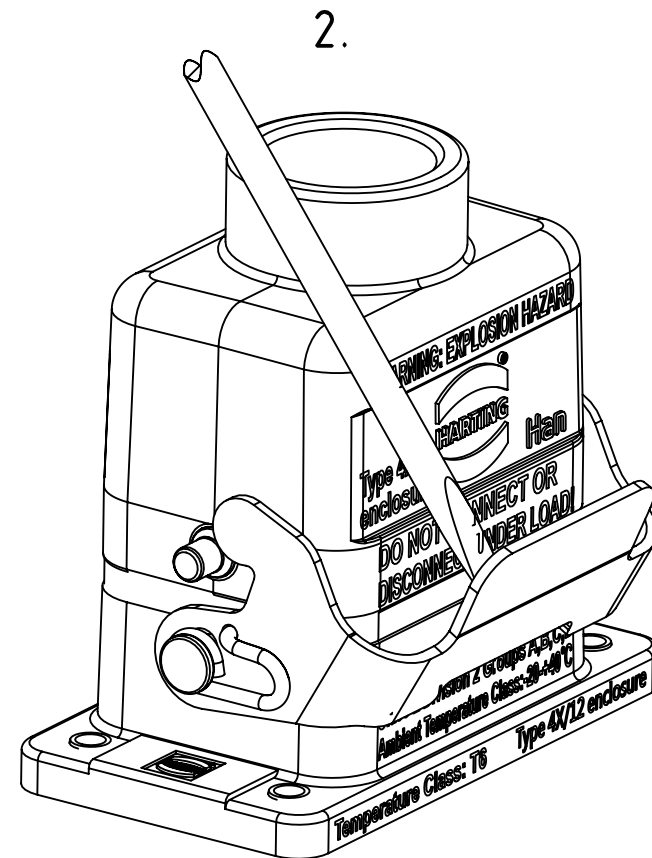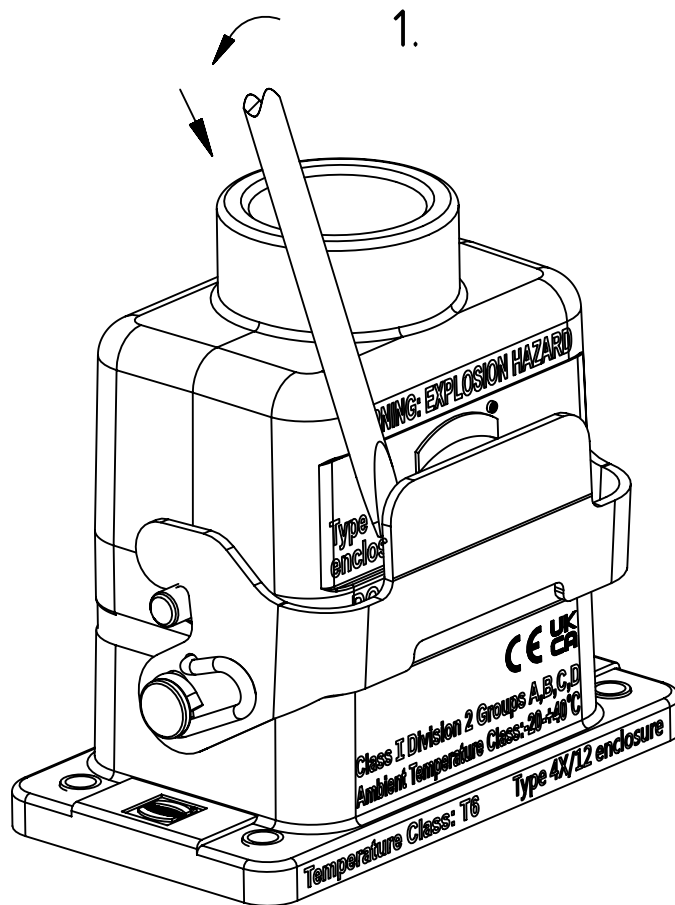

To separate connectors, insert small flat head tool or screwdriver between metal lever and housing as shown in the diagram,. Press screwdriver in a downward direction until the metal lever releases.

To secure the hood and housing assembly together, press the metal levers in the upward direction until metal lever latches into housing pins.