
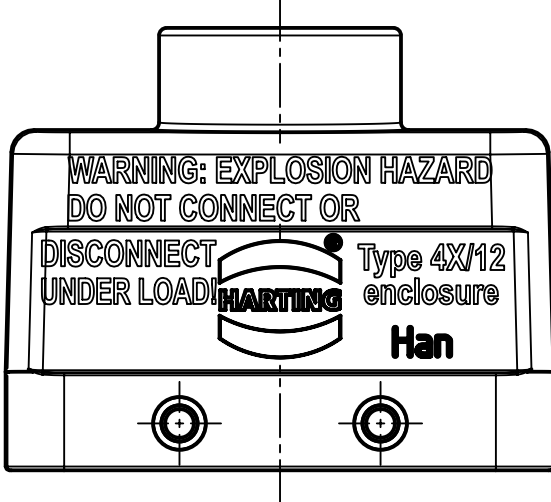
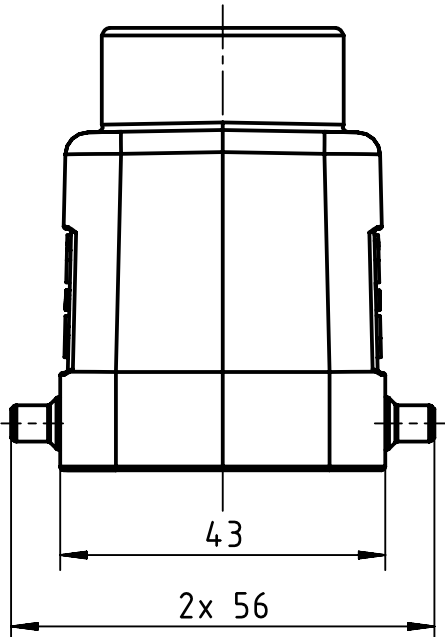
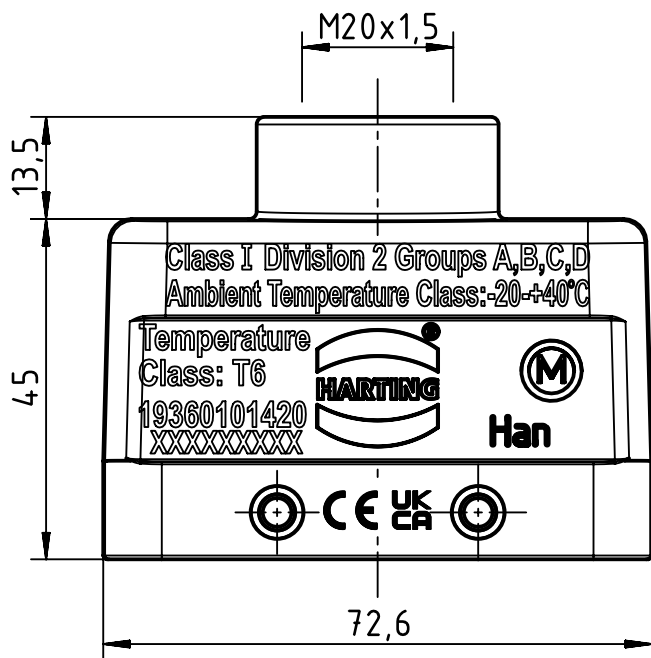


FOR USE WITH AWG 12, 14 AND 16

FOR USE WITH CABLE TYPE:
PLTC, PLTC-ER, ITC, ITC-ER, MC, MV AND TC



FOR USE IN CLASS I, DIVISION 2 GROUPS A, B, C AND D
HAZARDOUS LOCATIONS OR UNCLASSIFIED LOCATIONS

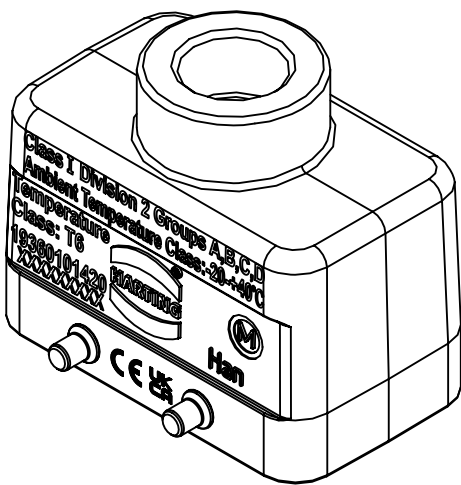

WARNING
EXPLOSION HAZARD
DO NOT CONNECT
OR DISCONNECT
UNDER LOAD!

THE INSTALLATION MUST BE IN
ACCORDANCE WITH THE
ASSOCIATED LOCATION
RESTRICTIONS OF THE NATIONAL
ELECTRIC CODE OR CANADIAN
ELECTRICAL CODE AS
APPLICABLE, INCLUDING ISSUES
SUCH AS THE ROUTING,
SUPPORT AND LENGTH OF THE
INVOLVED CORD OR CABLE.

		All Dimensions in mm Original Size DIN A3		Scale 1:1	Free size tol.	Ref.		
						Sub.		
	All rights reserved		Created by longl	Inspected by wangst	Standardisation	Date 25-Jun-2025	State 40 - Released	
	Department EL PD		Title HAN 10EX UL-HTE-M20				Doc-Key / ECM-Nr. DS00199067	
HARTING D-32339 Espelkamp			Type TB	Design Number DS00199067	SAP Mat. Number 19365101420		Rev. D	Page 1/2

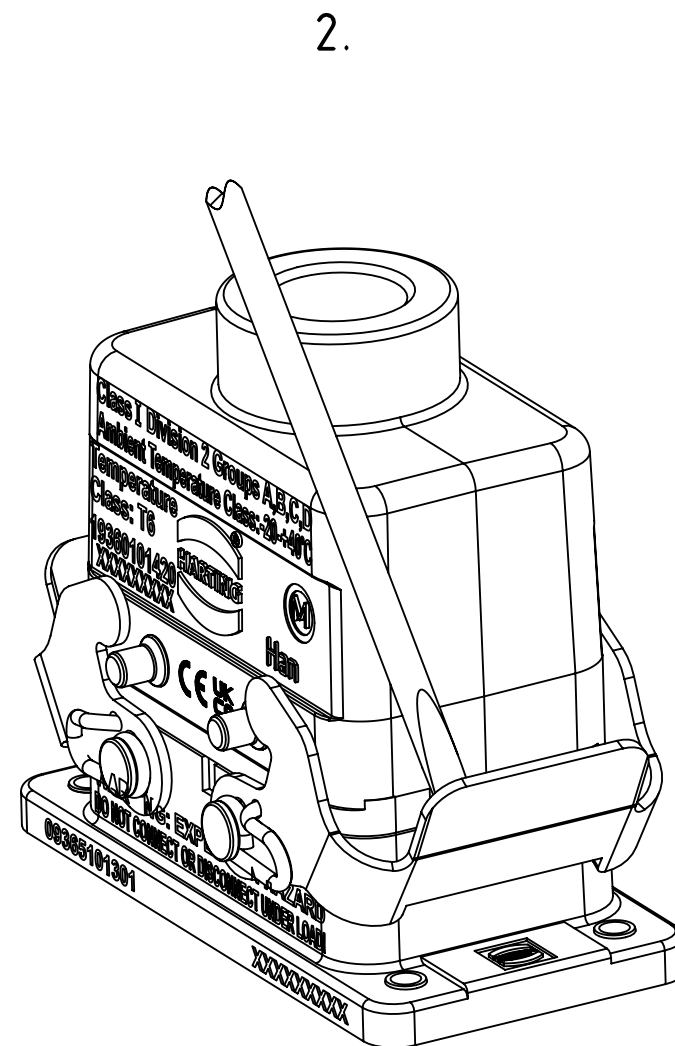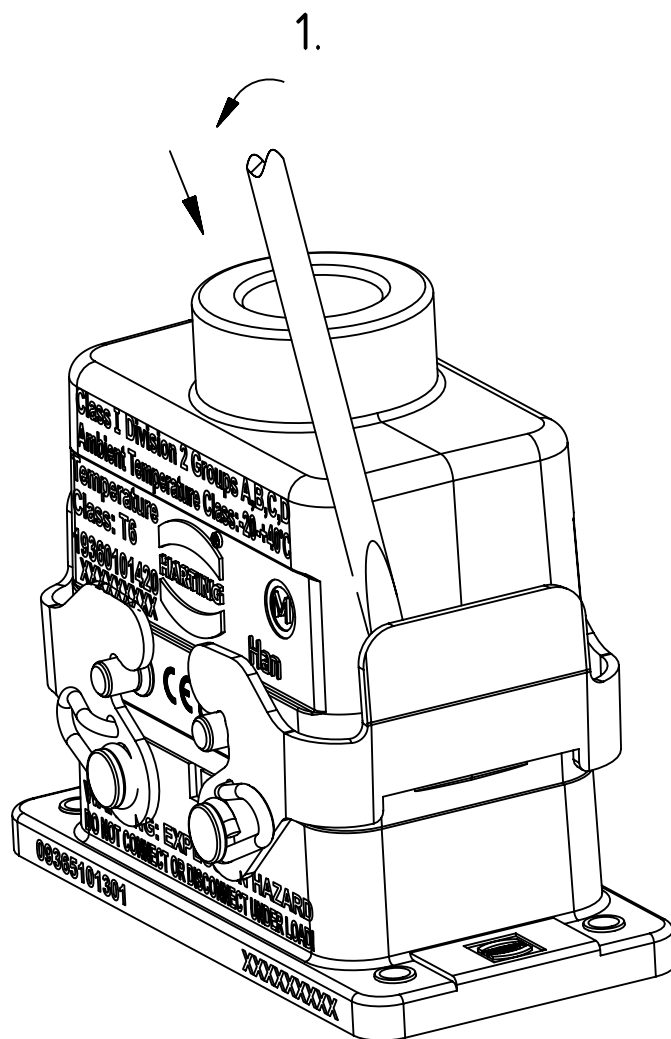

To separate connectors, insert small flathead tool or screwdriver between metal lever and housing as shown in the diagram,. Press screwdriver in a downward direction until the metal lever releases.

To secure the hood and housing assembly together, press the metal levers in the upward direction until metal lever latches into housing pins.