
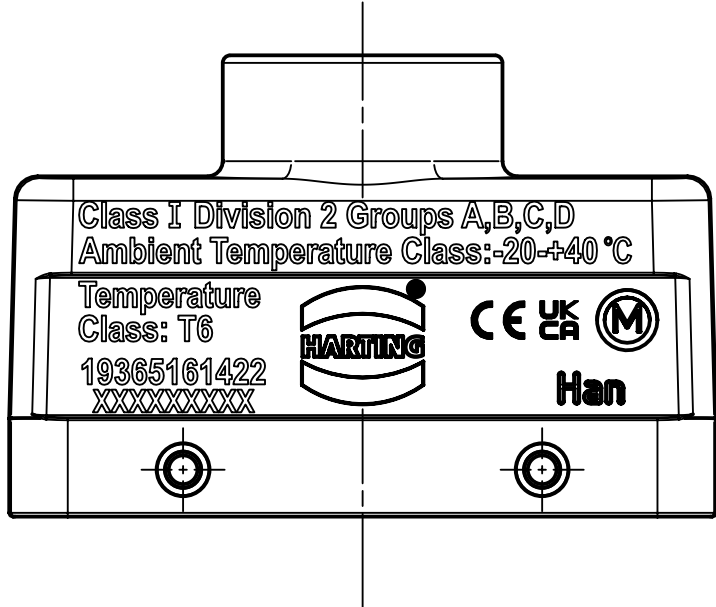
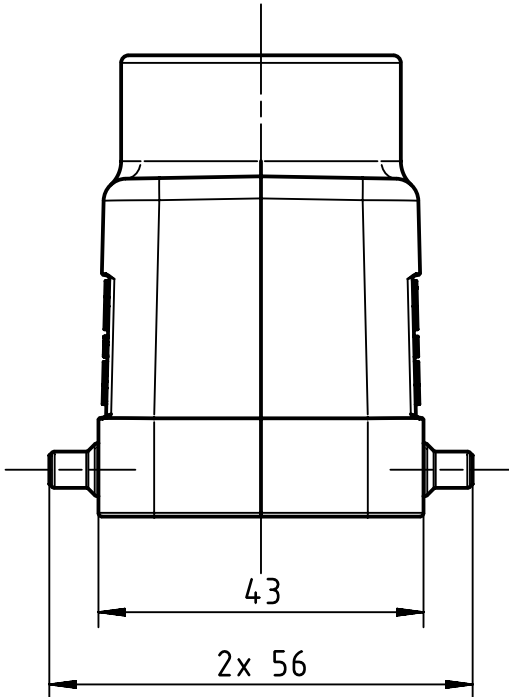
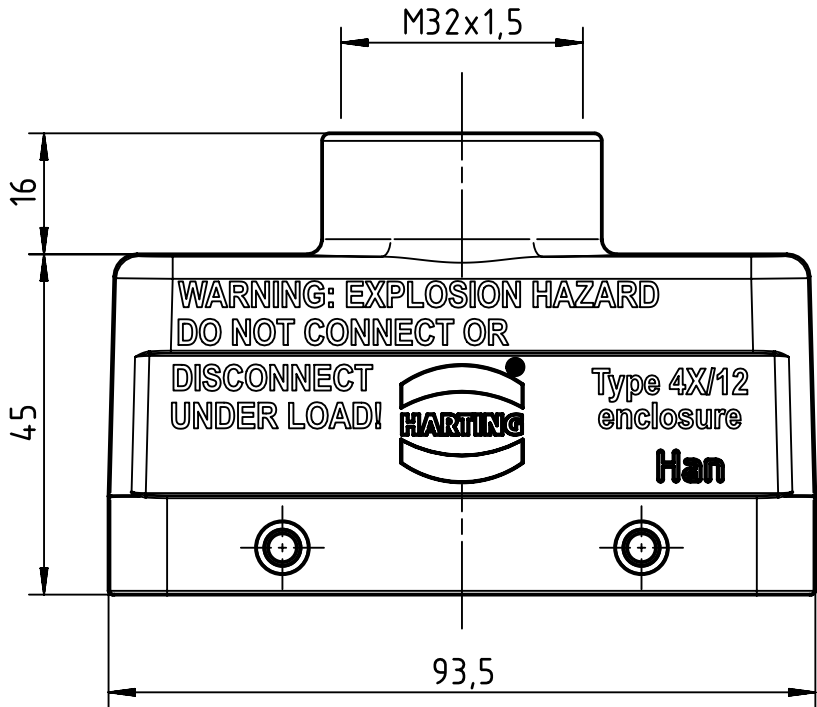


FOR USE WITH AWG 12, 14 AND 16

FOR USE WITH CABLE TYPE:
PLTC, PLTC-ER, ITC, ITC-ER, MC, MV AND TC



FOR USE IN CLASS 1, DIVISION 2, GROUP A,B,C, AND D
HAZARDOUS LOCATIONS OR UNCLASSIFIED LOCATIONS

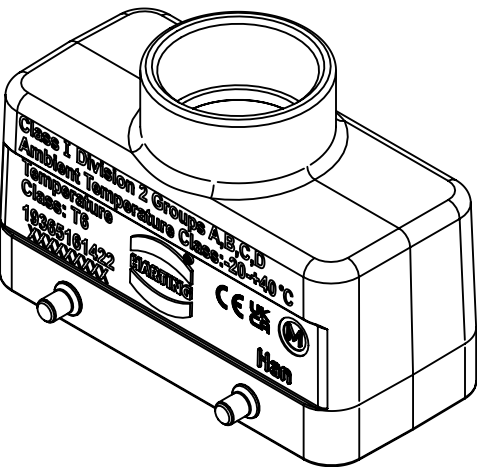

WARNING
EXPLOSION HAZARD
DO NOT CONNECT
OR DISCONNECT
UNDER LOAD!

THE INSTALLATION MUST BE IN
ACCORDANCE WITH THE ASSOCIATED LOCATION
RESTRICTIONS OF THE NATIONAL ELECTRIC CODE
OR CANADIAN ELECTRICAL CODE AS APPLICABLE,
INCLUDING ISSUES SUCH AS ROUTING, SUPPORT
AND LENGTH OF THE INVOLVED CODE OR CABLE.

		All Dimensions in mm Original Size DIN A3		Scale 1:1		Free size tol.		Ref.						
								Sub.						
	All rights reserved			Created by longl		Inspected by wangst		Standardisation		Date 25-Jun-2025		State 40 - Released		
	Department EL PD			Title Han 16Ex UL-HTE-M32								Doc-Key / ECM-Nr. DS00199108		
HARTING D-32339 Espelkamp				Type TB		Design Number DS00199108			SAP Mat. Number 19365161422			Rev. D		Page 1/2

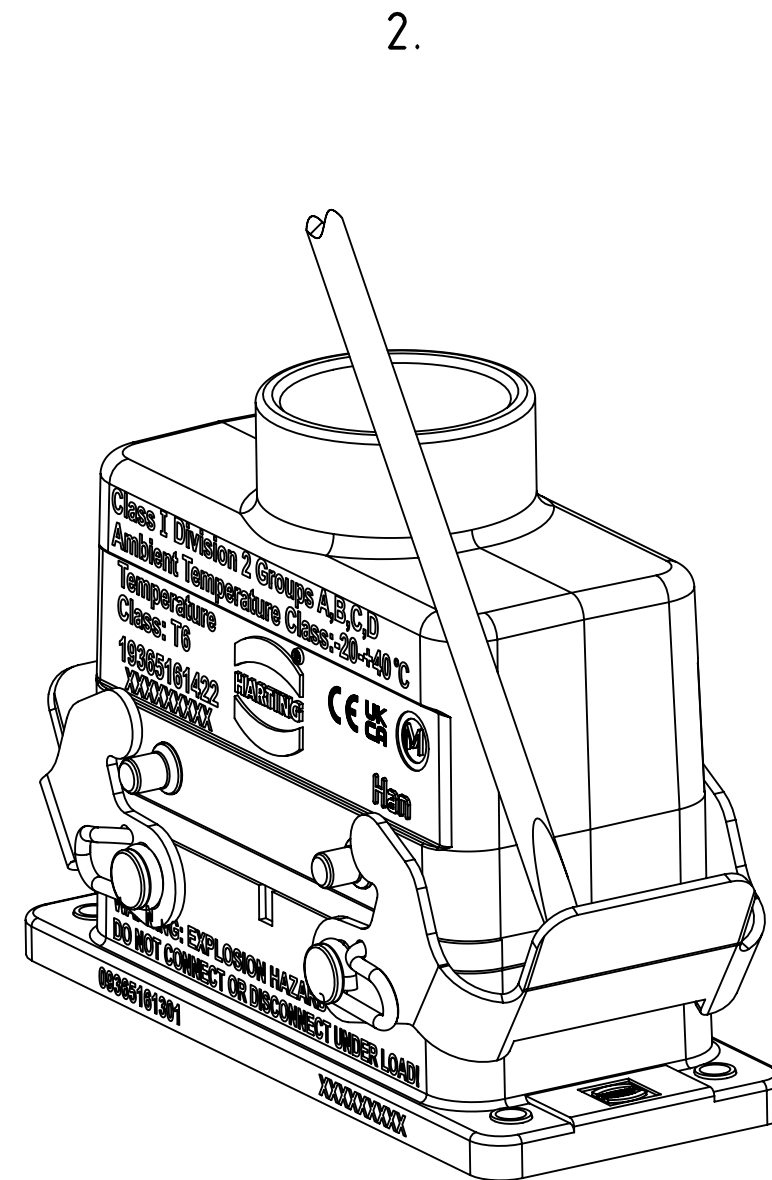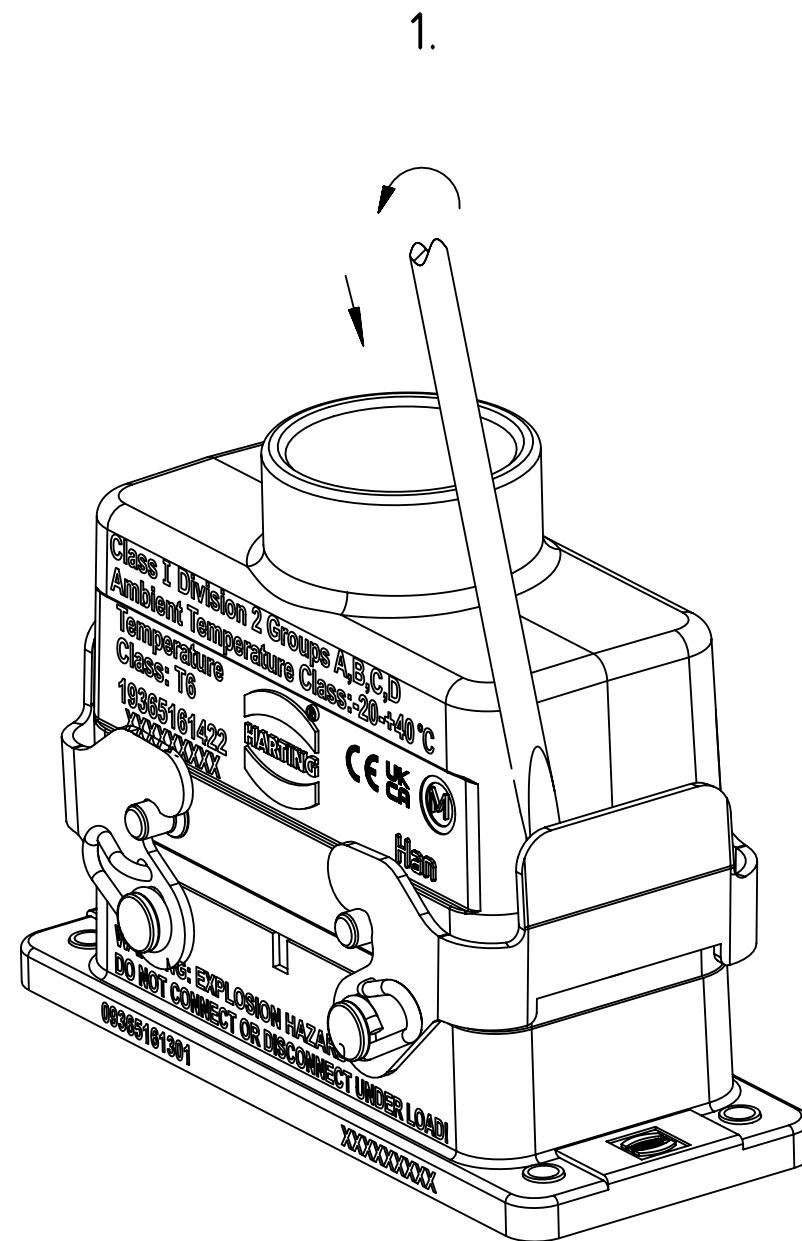

To separate connector, insert small flat head tool or screwdriver between metal lever and housing as shown in the diagram, press the screwdriver in a downward direction until the metal lever releases.

To secure the hood and housing assembly together, press the metal lever upward direction until metal lever latches into housing pins.