
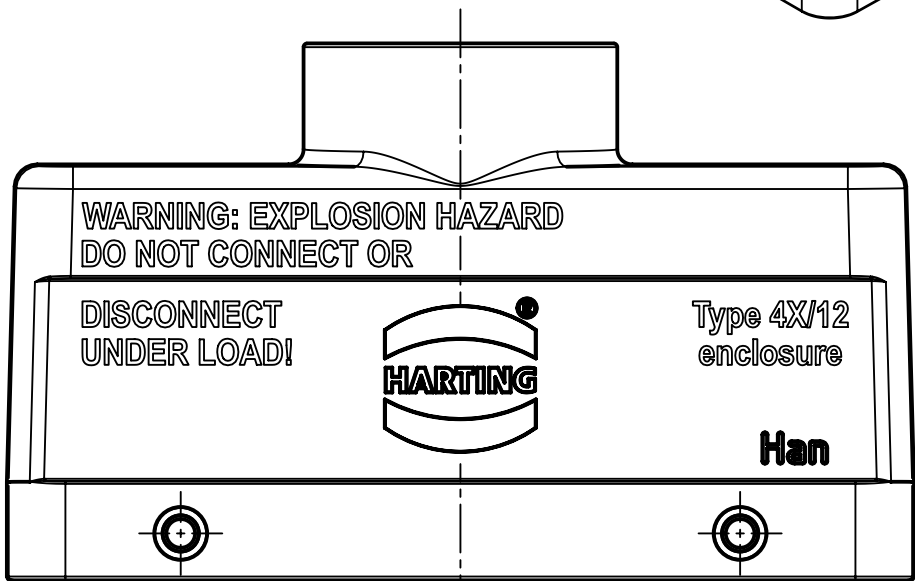
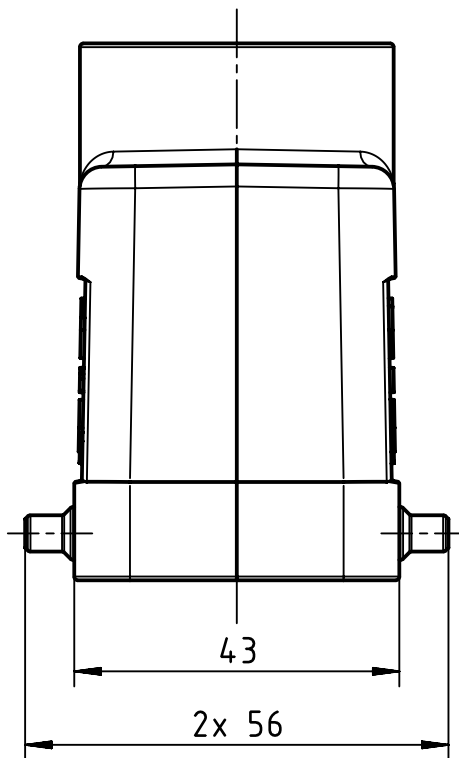


FOR USE WITH AWG 12, 14 AND 16

FOR USE WITH CABLE TYPE:
PLTC, PLTC-ER, ITC, ITC-ER, MC, MV AND TC


FOR USE IN CLASS I, DIVISION 2 GROUPS A, B, C AND D
HAZARDOUS LOCATIONS OR UNCLASSIFIED LOCATIONS


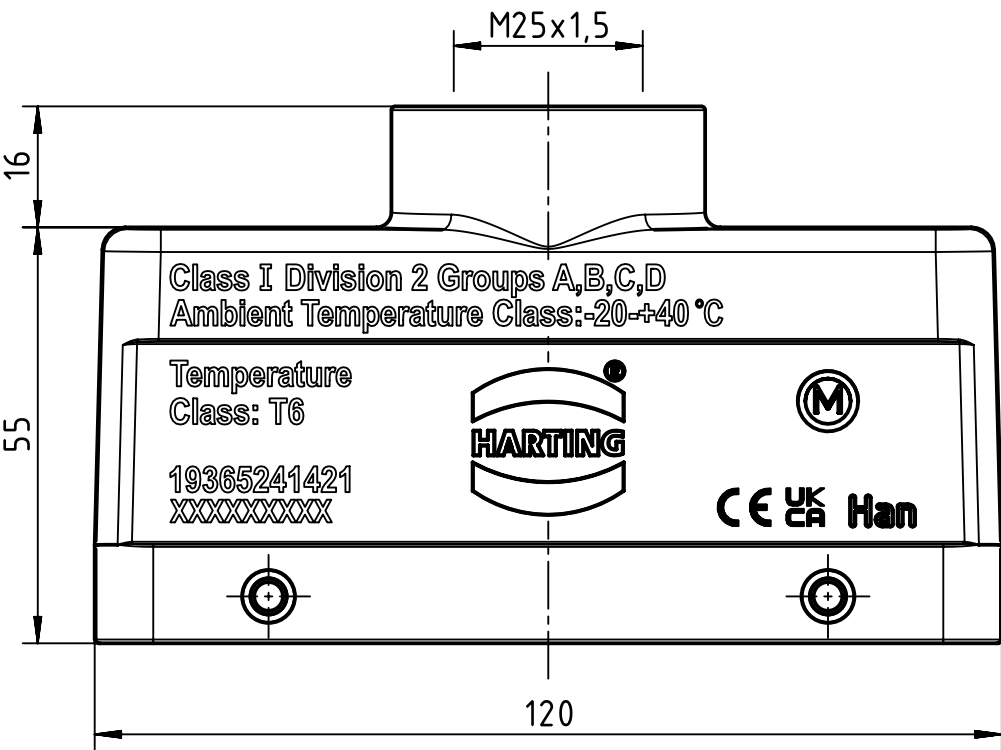


WARNING
EXPLOSION HAZARD
DO NOT CONNECT
OR DISCONNECT
UNDER LOAD!

THE INSTALLATION MUST BE IN
ACCORDANCE WITH THE
ASSOCIATED LOCATION
RESTRICTIONS OF THE NATIONAL
ELECTRIC CODE OR CANADIAN
ELECTRICAL CODE AS
APPLICABLE, INCLUDING ISSUES
SUCH AS THE ROUTING,
SUPPORT AND LENGTH OF THE
INVOLVED CORD OR CABLE.

		All Dimensions in mm Original Size DIN A3		Scale 1:1		Free size tol.		Ref.					
								Sub.					
		All rights reserved		Created by longl		Inspected by wangst		Standardisation		Date 25-Jun-2025		State 40 - Released	
		Department EL PD											
HARTING D-32339 Espelkamp				Title HAN 24EX UL-HTE-M25								Doc-Key / ECM-Nr. DS00199093	
				Type TB		Design Number DS00199093		SAP Mat. Number 19365241421		Rev. D		Page 1/2	

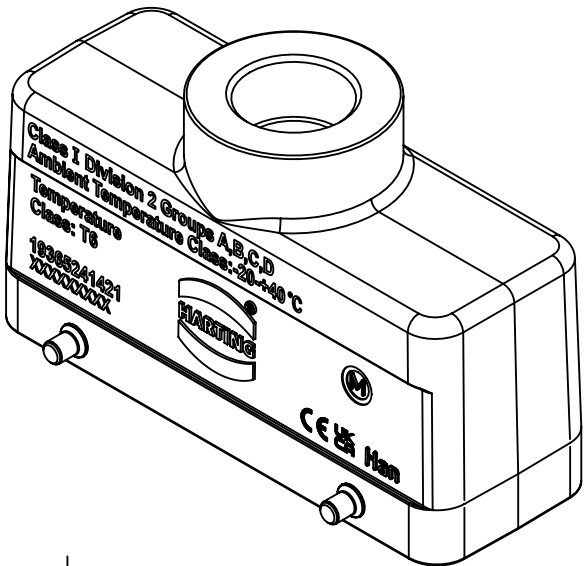

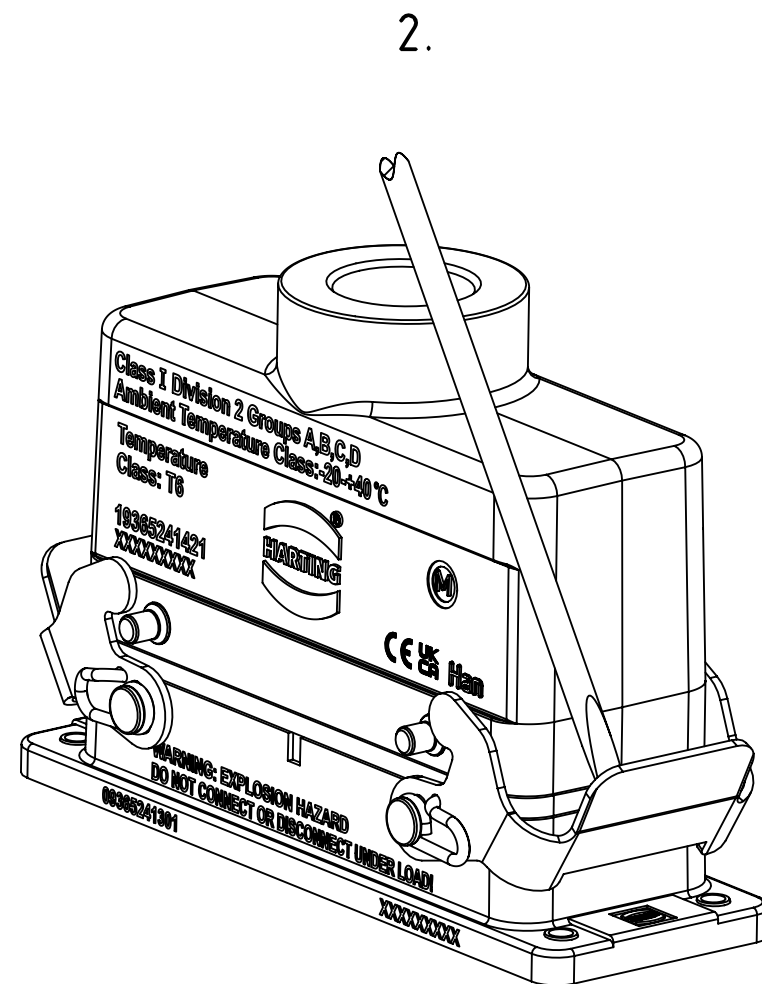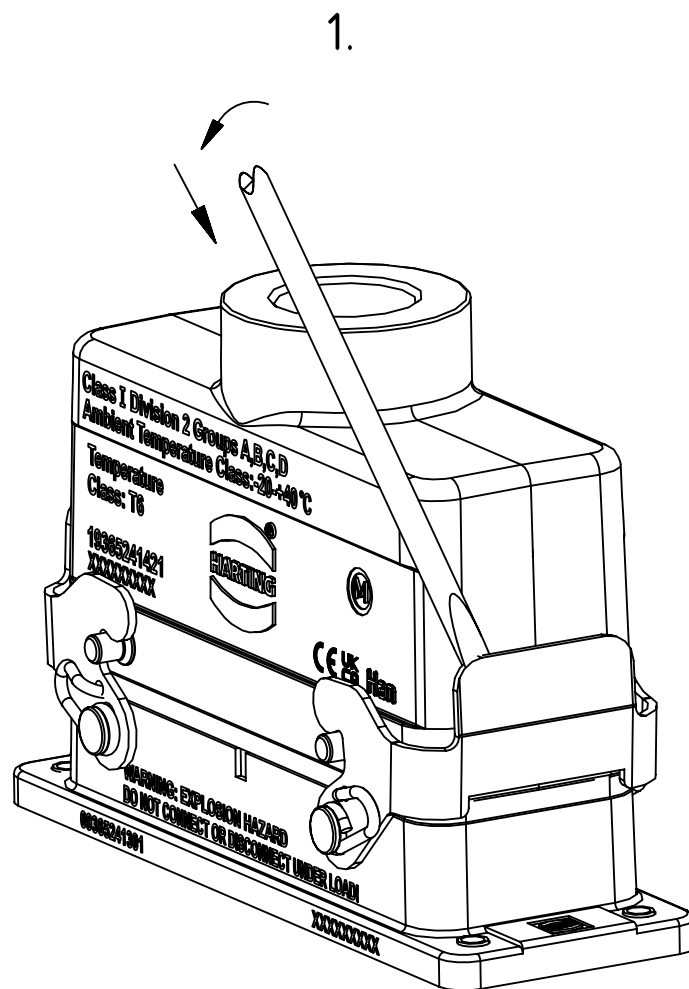

To separate connectors, insert small flat head tool or screwdriver between metal lever and housing as shown in the diagram,. Press screwdriver in a downward direction until the metal lever releases.

To secure the hood and housing assembly together, press the metal levers in the upward direction until metal lever latches into housing pins.